


MEMC Electronic Materials Sdn. Bhd. (Kuala Lumpur, Malaysia)



Outdoor

Chiller Plant Room Refrigerant Gas Monitor (Leak Detection) Installation Layout

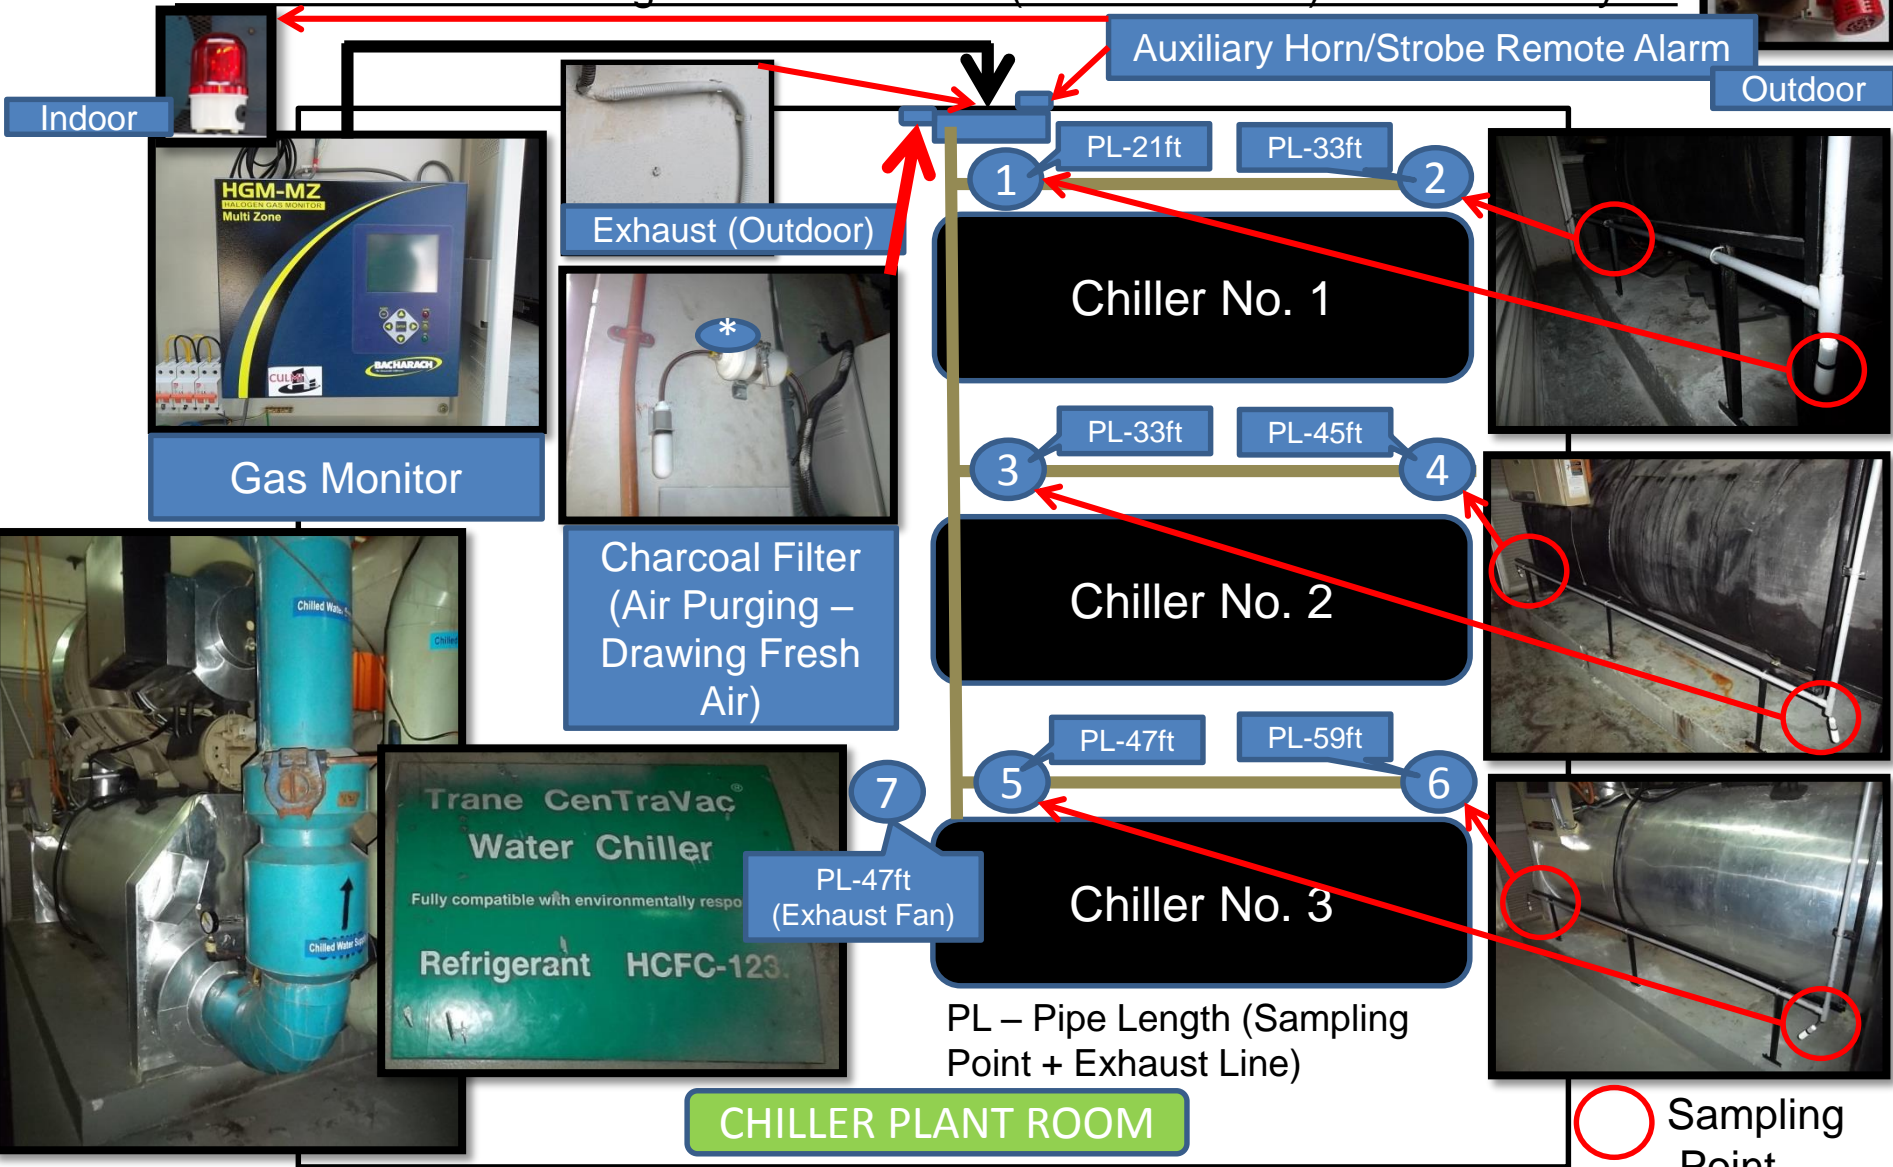

* A purge line is installed to provide clean air for resetting the infrared zero baseline (Replacement every six months to 1-year depends on the condition).